



BAL1400TD
INSTALLATION INSTRUCTIONS
FLUORESCENT EMERGENCY BALLAST
1400 LUMENS (TIME DELAY)

***WHEN USING THIS LIGHTING DEVICE, SAFETY PRECAUTIONS SHOULD BE FOLLOWED AT ALL TIMES
READ THE INSTRUCTIONS BELOW CAREFULLY AND FOLLOW THEM FOR YOUR OWN SAFETY!***

1. Prior to installation, battery connector must be left open to prevent high voltage from being present on output leads (red & yellow). It must be connected only after installation is complete and A.C. Power is supplied to the unit.
2. This unit can operate commonly used linear and compact fluorescent lamps. Please refer to the "lamps list" label on the ballast for specific lamp information.
3. Please ensure the electricity connections conform to the National Electrical Code and local regulations if applicable.
4. To avoid electric shock, please disconnect normal and emergency power supplies, and battery connector of the emergency ballast before servicing.
5. This device is designed for factory or field installation in either the ballast channel, or on top of the fixture, except air handling heated air outlets, wet or hazardous location fixtures. Do not install this device near gas or electric heaters.
6. AC power source of 120 VAC or 277 VAC is required.
7. The battery in this unit is sealed, and not replaceable in the field. Please contact manufacturer for information on servicing the battery.
8. Do not use accessory equipment that is not recommended by manufacturer. Failure to do so may cause unsafe conditions. Servicing should only be performed by qualified service personnel.
9. Do not use the product for other than its intended purpose.

CAUTION: Verify that all replacement lamp types marked on the installed luminaire are also identified as suitable for use with this inverter/charger pack.

PLEASE SAVE THESE INSTRUCTIONS.

INSTALLATION INSTRUCTIONS

CAUTION: Before installing, make certain the A.C. Power is off and the battery connector is disconnected.

1. MOUNTING THE EMERGENCY BALLAST (BATTERY PACK)

Remove the ballast channel cover. Mount the **EMERGENCY BALLAST** in the ballast channel at least $\frac{1}{2}$ " away from the A.C. Ballast(s).

When battery packs are remote mounted, the remote distance can not exceed $\frac{1}{2}$ of the distance from ballast to lamp specified by the A.C. ballast manufacturer. For example, if the A.C. ballast manufacturer recommends no more than 25' remote distance, then the battery pack's remote mounting distance should not exceed $12\frac{1}{2}$ '. Under no circumstances should the battery pack exceed a distance of 50' from the lamp(s).

2. WIRING

Refer to the wiring diagrams on the back page for the appropriate wiring of lamp(s) and ballast. Install in accordance with the National Electrical Code and local regulations. For additional wiring diagrams consult Customer Service.

3. INSTALLING THE LED COMBO TEST SWITCH (LCTS)

Recessed Troffer Fixture - Select a convenient location with proper clearance in the ballast cover and drill or punch a $\frac{7}{8}$ " hole ($\frac{1}{2}$ " knockout). Insert the $\frac{7}{8}$ " bushing into the hole. Push the plastic tube through the bushing. Route the leads of the **LCTS** through the plastic tube. Connect the wires from the unit to the **LCTS** (VIOLET to VIOLET, BROWN to BROWN). Push the entire assembly back into the tube until the lens collar rests against the plastic tube. The plastic tube should be adjusted so that the **LCTS** is within $\frac{1}{4}$ " of the fixture lens. The **LCTS** must be visible after installation. Refer to *Illustration 1*.

Strip Fixture - Select a convenient location on the fixture so the **LCTS** can be seen after installation. Allow for proper clearance inside the fixture and drill or punch a $\frac{1}{2}$ " hole. Remove the nut from the **LCTS**. Push the **LCTS** housing into the $\frac{1}{2}$ " hole and secure with the nut. Connect the wires from the **LCTS** (VIOLET to VIOLET, BROWN to BROWN). Refer to *Illustration 2*.

Illustration 1


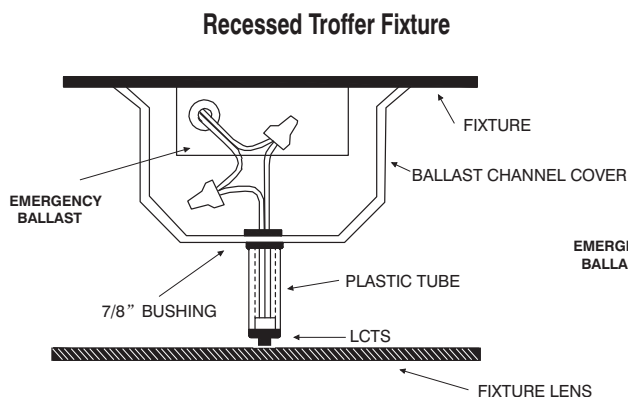


Illustration 2

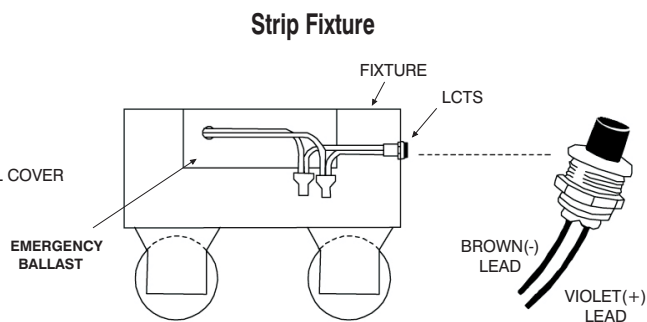


OBSERVE PROPER POLARITY

4. WIRING THE A.C. INPUT

- The **EMERGENCY BALLAST** and A.C. Ballast **must** be on the same branch circuit.
- The **EMERGENCY BALLAST** requires an **unswitched** A.C. Power source of either 120 or 277 volts. Select proper voltage lead and cap the unused lead.
- When the **EMERGENCY BALLAST** is used with a switched fixture, the A.C. Input to the **EMERGENCY BALLAST** must be connected ahead of the fixture switch. Refer to *Illustration 3* for switched and unswitched fixture wiring diagrams.

5. BALLAST WIRING BLOCK DIAGRAM

Illustration 3

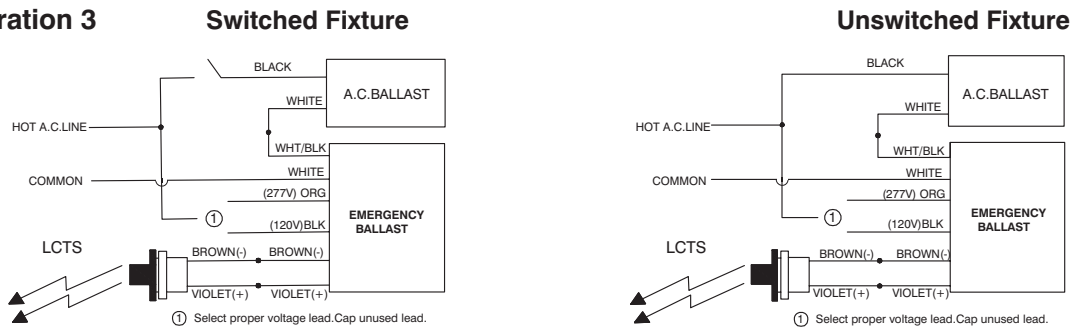

6. LABELS

Attach the appropriate labels adjacent to the **LCTS**. Annotate Re-lamping label for lamp type and wattage. The 'Caution' and the 'Re-lamping' labels must be on the fixture in a readily visible location to anyone attempting to service the fixture.

7. COMPLETING INSTALLATION

When the installation is complete, switch the A.C. power ON and join the **EMERGENCY BALLAST'S** unit connector.

OPERATION

Normal Mode - A.C. power is present. The A.C. ballast operates the fluorescent lamp(s) as intended. The **LCTS** will be lit providing a visual indication that the **EMERGENCY BALLAST** is in the standby charging mode.

Emergency Mode - A.C. power fails. The **EMERGENCY BALLAST** senses the A.C. power failure and automatically switches to the *Emergency Mode*. One or two lamps illuminate at reduced output, for a minimum of 90 minutes. When A.C. Power is restored, the **EMERGENCY BALLAST** switches the system back to the *Normal Mode* and resumes battery charging.

TESTING & MAINTENANCE

Pressing the red lens on the **LCTS** turns off the light on it, interrupts power to the designated A.C. ballast and forces the unit into emergency mode. The emergency lamp (s) is (are) now lit by the **EMERGENCY BALLAST**. On releasing the lens, fixture returns to normal mode after a momentary delay. To simulate a "BLACK OUT" use the circuit breaker to turn off the AC power.

Initial Testing - Allow the unit to charge for approximately 1 hour, then press the **LCTS** to conduct a short discharge test. Allow a 24 hour charge before conducting a 1½ hour test.

This **EMERGENCY BALLAST** is a maintenance free unit, however, periodic inspection and testing is required. NFPA 101, Life Safety Code, outlines the following schedule:

Monthly - Insure that the **LCTS** is illuminated. Conduct a 30 second discharge test by depressing the **LCTS**. One lamp should operate at reduced output.

Annually - Insure that the **LCTS** is illuminated. Conduct a full 1½ hour discharge test. The unit should operate as intended for the duration of the test.

"Written records of testing shall be kept by the owner for inspection by the authority having jurisdiction."

SERVICING SHOULD BE PERFORMED BY QUALIFIED PERSONNEL.


WIRE DIAGRAMS FOR LAMP EMERGENCY OPERATION

EMERGENCY BALLAST AND AC BALLAST MUST BE FED FROM THE SAME BRANCH CIRCUIT


TYPICAL SCHEMATICS ONLY. MAY BE USED WITH OTHER BALLASTS. CONSULT THE FACTORY FOR OTHER WIRING DIAGRAMS.

For One Lamp Emergency Operation


A. One (1) Lamp Instant Start AC Ballast

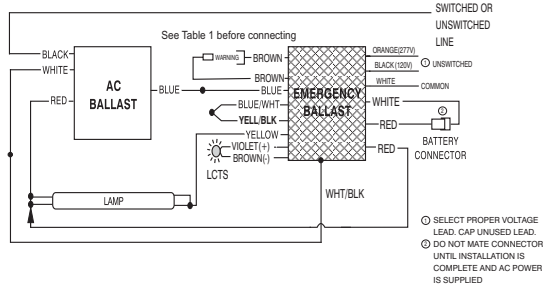


B. Two (2) Lamp Instant Start AC Ballast

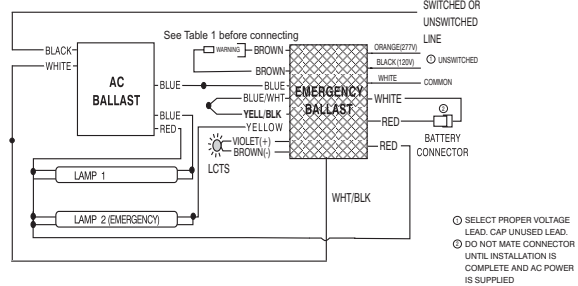


C. Three (3) Lamp Instant Start AC Ballast

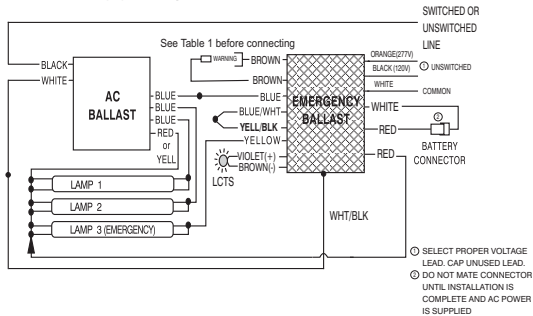


D. Four (4) Lamp Instant Start AC Ballast

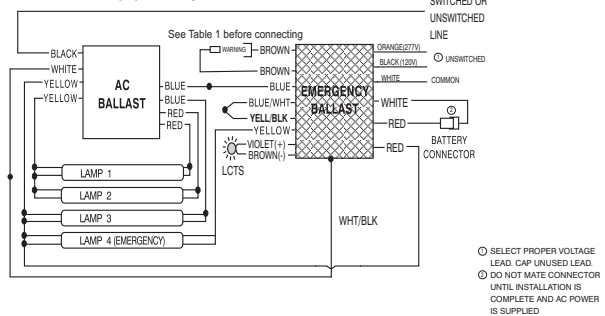


E. One (1) Lamp Rapid Start AC Ballast

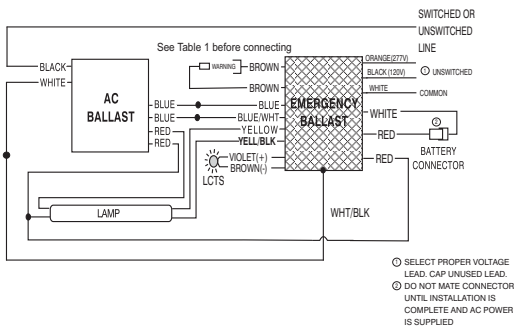


F. Two (2) Lamp Rapid Start AC Ballast

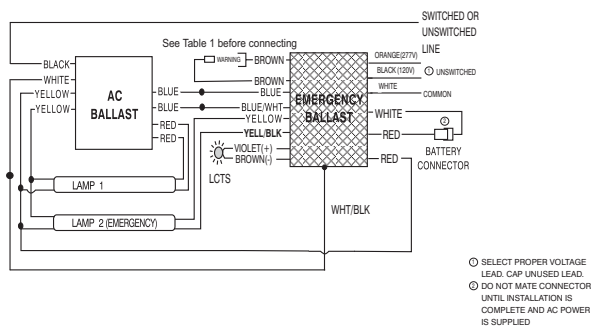

G. Three (3) Lamp Rapid Start AC Ballast

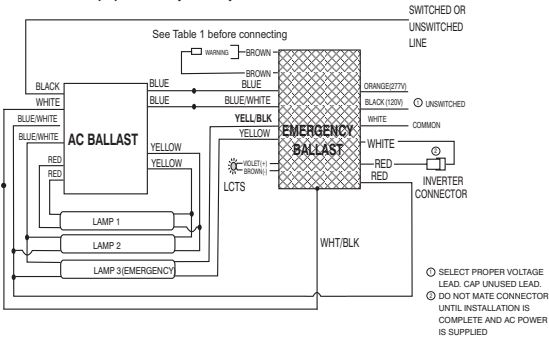

H. Four (4) Lamp Rapid Start AC Ballast

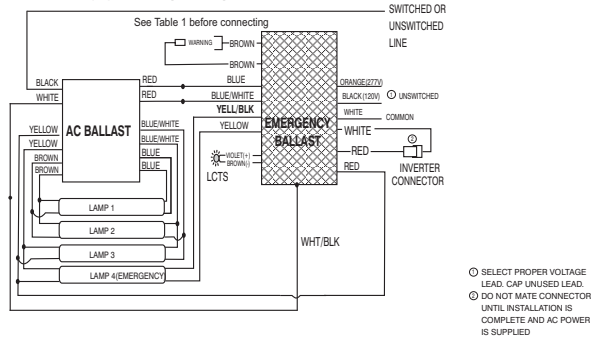

NOTE: Use the proper tap to cap unswitched AC lead


WIRE DIAGRAMS FOR LAMP EMERGENCY OPERATION

EMERGENCY BALLAST AND AC BALLAST MUST BE FED FROM THE SAME BRANCH CIRCUIT


TYPICAL SCHEMATICS ONLY. MAY BE USED WITH OTHER BALLASTS. CONSULT THE FACTORY FOR OTHER WIRING DIAGRAMS.

For Two Lamps Emergency Operation


A. Two (2) Lamp Instant Start AC Ballast

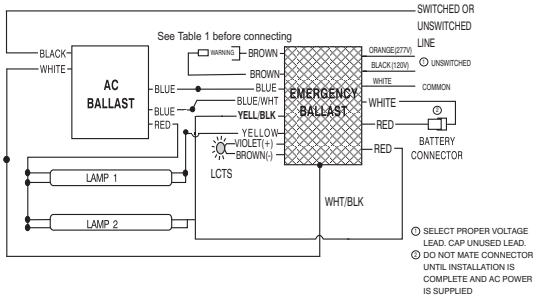


B. Three (3) Lamp Instant Start AC Ballast

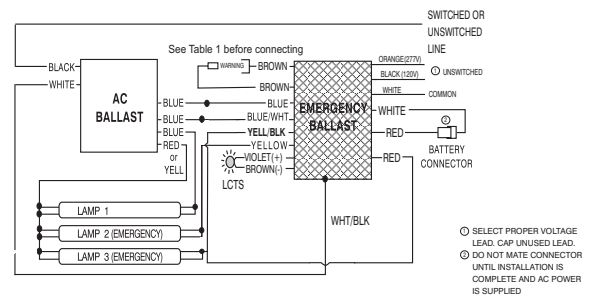

C. Four (4) Lamp Instant Start AC Ballast

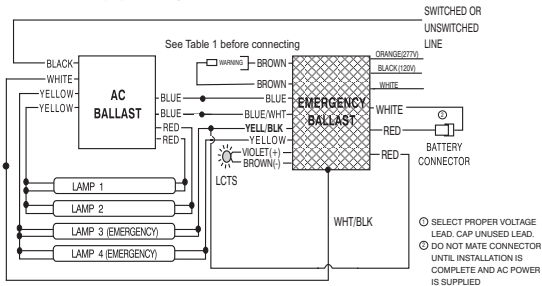


D. Two (2) Lamp Rapid Start AC Ballast

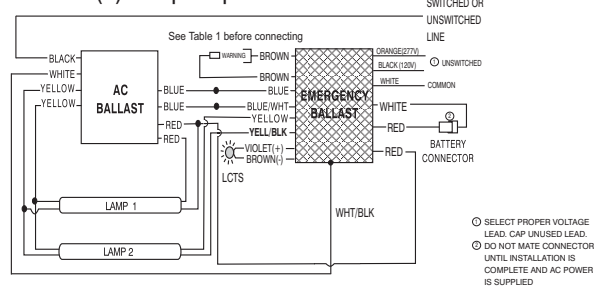


Emergency only Operation

A. One (1) Lamp Without AC Ballast

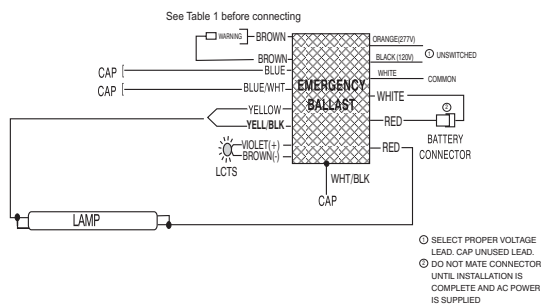

B. Two (2) Lamp Without AC Ballast

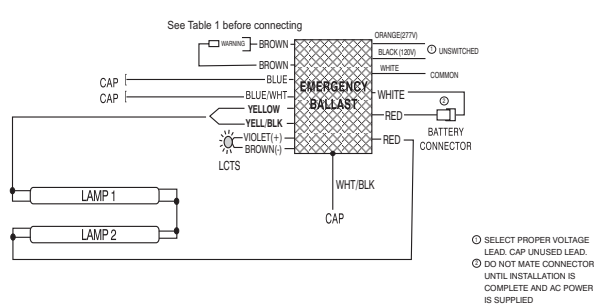

NOTE: Use the proper tap to cap unswitched AC lead

TABLE 1 (FOR BROWN CONNECTOR)

LAMP DIAMETER	BASE TYPE	WATTAGE (LENGTH)	NO.OF LAMPS (EMERGENCY MODE)	BROWN CONNECTOR
T5	SINGLE OR BIPIN	14,21,28,35W (2'-3'-4')	1	CLOSE
T5 HO	SINGLE OR BIPIN	24,39,54W (3'-4')	1	CLOSE
T5 HO	SINGLE OR BIPIN	24,39,54W (3'-4')	2	OPEN
T5	SINGLE OR BIPIN	14,21,28W (2'-3'-4')	2	OPEN
T8	SINGLE OR BIPIN	17,25,28,32,40W (2'-3'-4'-4'/5')	1	CLOSE
T8	SINGLE OR BIPIN	51,59W (5'-8')	1	OPEN
T8	SINGLE OR BIPIN	17,25,28,32,40W (2'-3'-4')	2	OPEN
T8HO	SINGLE OR BIPIN	44W	1	CLOSE
T8HO	SINGLE OR BIPIN	86W (8')	1	OPEN
T12	SINGLE OR BIPIN	20,25,34,40W (2'-4')	2	OPEN
T12	SINGLE OR BIPIN	20,25,30,34,40W (2'-4')	1	CLOSE
T12	SINGLE OR BIPIN	75W (5'/8')	1	OPEN
T12HO	SINGLE OR BIPIN	95,110,160,215W (8')	1	OPEN
Compact	G24q-1(4pin) G24q-2(4pin) G24q-3(4pin) G24q-4(4pin) G24q-5 (4pin)	13,18,21,26,32,42,57W	1	CLOSE
Compact	G24q-1(4pin) G24q-2(4pin) G24q-3(4pin) G24q-4(4pin)	13,18,21,26,32,42W	2	OPEN
Compact	2G11(4pin)	18,24,36,40,50,55W	1	CLOSE
Compact	2G11(4pin)	18,24,36,40,50W	2	OPEN
Compact	GR10q-4(4pin)	10,16,21,28,38,55W	1	CLOSE
Compact	GR10q-4(4pin)	10,16,21,28,38W	2	OPEN
Circular T9	4-pin	20,32,40W	1	CLOSE
Circular T9	4-pin	20,32,40W	2	OPEN
Circular T5	4-pin	22,40,55W	1	CLOSE
Circular T5	4-pin	22,40W	2	OPEN
U-bend T8	Bi-pin	32W	1	CLOSE
U-bend T8	Bi-pin	32W	2	OPEN
U-bend T12	Bi-pin	34,40W	1	CLOSE
U-bend T12	Bi-pin	34,40W	2	OPEN