

OLLO INDUSTRIAL EMERGENCY LIGHT

INSTALLATION AND OPERATING INSTRUCTION

IMPORTANT SAFEGUARDS

When using electrical equipment, basic safety precautions should always be followed including the following:

READ AND FOLLOW ALL SAFETY INSTRUCTIONS

- 1. Install in accordance with all national and local electrical codes.
- 2. Disconnect power at circuit breaker or fuse before installing or servicing the fixture.
- 3. DO NOT mount in hazardous locations, near gas or near electric heaters.
- 4. DO NOT let power cords contact hot surfaces.
- 5. Equipment should be mounted in locations and at heights where it will not be r readily subject to tampering by unauthorized personnel.
- 6. DO NOT use accessory equipment not recommended by the manufacturer. The use of such equipment may cause unsafe conditions and will void the unit's warranty.
- 7. DO NOT use this equipment for other than its intended purpose.
- 8. All servicing should be performed by qualified personnel only.
- 9. Allow battery to charge for 24 hours before first use.
- 10. For indoor use only, unless LW (Wet Location) option is selected.

SAVE THESE INSTRUCTIONS

31 Waterloo Ave • Berwyn, Pa • 19312 U.S.A Telephone: (610) 647-8200 • Email: support@isolite.com

WET LOCATION NOTES

Ensure thorough weatherproofing by applying silicon sealant to all knockout openings in the weatherproof outdoor box, remember to apply silicon sealant to all threaded connections, including plugs and conduit fittings, for optimal protection against outdoor elements.

BASIC FUNCTIONALITY & FEATURES

FIGURE 1: Test Button located on Face Plate in the center


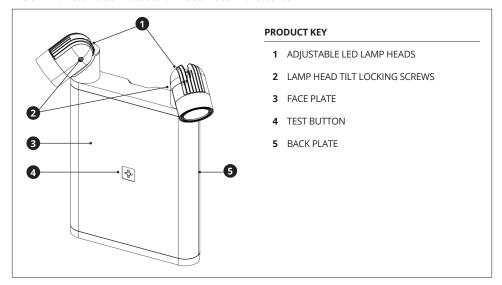


FIGURE 2

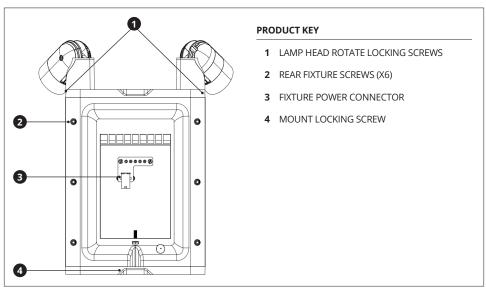

INSTALLATION INSTRUCTIONS - BACK MOUNT

FIGURE 3


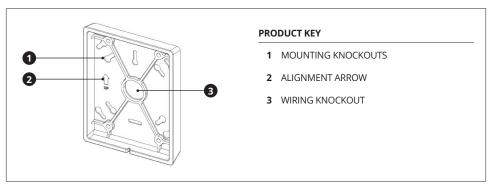


FIGURE 4

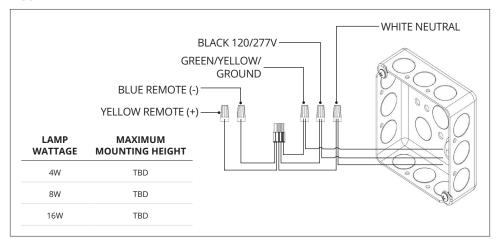

- PREPARE THE MOUNTING: Remove Knockouts: Identify and remove the appropriate knockouts on the mounting box.
- 2. **CONNECT THE WIRE ASSEMBLY:** Wire Connections: Connect the wire adapter to the power supply wires using the provided wire nuts and cap any unused wires. Follow local electrical codes. Refer to the wiring details for your specific fixture:

ALL UNITS:

Black wire: 120-277 VAC universal input

White wire: Neutral

Green/Yellow wire: Ground

Yellow wire: Remote lamp positive (+) (9.6 VDC)

Blue wire: Remote lamp negative (-)

- **3. GUIDE THE WIRES:** Pigtail Wires: Guide the wire adapter through the knockout on the mounting plate.
- **4. ATTACH THE MOUNTING PLATE:** Mounting Surface: Attach the mounting plate to the mounting surface or junction box using the pre-established holes. **NOTE:** Ensure the notch on the back plate is oriented downward (the up arrow should point up)

INSTALLATION INSTRUCTIONS - BACK MOUNT

CONTINUED

- **5. LEVEL AND TIGHTEN THE MOUNTING BOX:** Level Check: Ensure the mounting box is level and fully tighten the screws.
- **6. CONNECT THE WIRE ADAPTER TO THE FIXTURE:** Connection: Make the electrical connection from the back plate to the unit.
- 7. HANG THE FIXTURE: Mount the Unit: Hang the unit onto the back plate.
- **8. SECURE THE FIXTURE:** Locking Screw: Use a #11 Allen wrench to tighten the locking screw located at the bottom of the unit to secure it in place.
- **9. ADJUST THE LAMP HEADS:** Lamp Adjustment: Adjust the lamp heads and secure the lamp heads in place by taking a #11 Allen Wrench and tighten to achieve the desired emergency illumination. (See "Lamp Adjustment" Section).

POLE MOUNT

- **1. DRILL HOLES:** Use a 7/32" drill bit to create 4 holes in the mounting box at the indicated locations.
- **2. ATTACH BRACKETS:** Secure pole mount brackets with supplied hardware as shown in Figure #6 below.
- **3. THREAD CLAMP:** Open the worm gear clamp, then thread it through the slots in the pole mount brackets.
- **4. MOUNT TO POLE:** Place the mounting box with the attached brackets and worm gear clamp around the pole. Tighten the worm gear clamp to secure the assembly firmly to the pole.

FIGURE 5




FIGURE 6





FIGURE 7



OLLOR INSTALLATION INSTRUCTIONS: FLUSH MOUNT

- 1. REMOVE THE KNOCKOUTS: Remove the appropriate knockouts on the mounting plate for the selected back mount.
- 2. CONNECT WIRES: Connect the wires to the master unit wires using 18 AWG wire (Supplied by Others), following local electrical codes. The wiring is as follows:

ALL UNITS:

Yellow Wire: Remote Lamp Positive (+) (9.6VDC)

Blue Wire: Remote Lamp Negative (-)

- **3. GUIDE THE WIRES:** Feed the wires through the knockout on the mounting plate.
- 4. ATTACH THE MOUNTING PLATE: Secure the mounting box to the mounting surface or junction box using the pre-drilled holes. Ensure the notch on the back plate is oriented down and the arrow is pointing up.
- 5. LEVEL AND TIGHTEN: Check that the mounting box is level, then fully tighten the screws.
- 6. CONNECT TO REMOTE UNIT: Make wire connections from the back plate to the remote unit
- 7. HANG THE UNIT: Hang the unit on the back plate.
- 8. SECURE THE UNIT: Tighten the locking screw at the bottom of the remote unit.
- 9. ADJUST LAMP HEADS: Adjust the lamp heads to achieve the desired emergency illumination. (See "Lamphead Adjustment" section).

FOR REMOTE HEAD POLE MOUNT INSTRUCTIONS PLEASE REFER TO PAGE 4.

OLLO LAMP ADJUSTMENTS

This Emergency Light features adjustable LED lamp heads with either one, two, or four lamp heads (model dependent). Each lamp head can fully swivel 350° degrees and can be tilted up to 90° degrees.

You can adjust each lamp head to narrow or widen the beam spread, allowing you to achieve the desired lighting coverage.

FIGURE 8





FIGURE 9



CONTINUE TO NEXT PAGE

SELF-TESTING / SELF-DIAGNOSTICS

This unit meets the requirements of NFPA 101 for Periodic Testing of Emergency Lighting Equipment. It provides visual indication of unit malfunctions including:

- 1. Battery Fault
- 2. Charger Fault
- 3. Transfer System Fault
- 4. Lamp Fault

SELF-TEST

An automatic self-test and diagnostic function will be performed every 28 days. A load test will be performed for 30 seconds checking for a lamp, battery or transfer system fault.

This automatic self-test and diagnostic function will be performed only if the battery is fully charged. If not, the test will automatically reschedule. The charger function is monitored continuously.

DEFEAT MONTHLY DIAGNOSTICS TESTING

The option to defeat the standard monthly testing is available as a factory option. This will allow the user to bypass the testing schedule that is provided standard with all units. If "DD" option is selected then this equipment is not self testing in conformance with the Life Safety Code, ANSI/NFPA 101.

USER-TEST

A manual USER-TEST can be performed for 30 seconds or 90 minutes. By pushing the "TEST" Button for 1 second, the lamps will illuminate for 30 seconds. If the "STATUS" indicator shows GREEN indicating a fully charged Battery and the Switch is pushed for 4 seconds, the lamps will illuminate for 90 minutes. If the Battery is not fully charged, the 30 second test will run. In either mode, the USER-TEST can be canceled by pushing and holding the "TEST" Switch for 1 second after the lamps turn on.

CLEARING FAILURE INDICATIONS

Failure indications can be cleared by correcting the indicated fault and pushing and holding the "TEST" Switch for 1 second.

STATUS INDICATIONS

STATUS DISPLAY	FUNCTION	ACTION
Fast Blinking (4 Blinks)	IR Signal	Stops after blinks completed
Slow Flashing Green	90 minute test mode	Wait for test sequence completion*
Flashing Green	30 second test mode	Wait for test sequence completion*
Alternate Red & Green	Insufficient charge for user test	Factory service required/battery replacement
Red Single Blink (ON / Pause)	Transfer system failure	Verify battery connection
Red Two Blinks (ON / Pause)	Battery failure	Factory service
Red Three Blinks (ON / Pause)	Charger failure	Replace lamps
Red Five Blinks (ON / Pause)	Lamp failure	Factory service
Flashing Orange	Heater energized	No action required
Solid Red	Fast charging	No action required
Solid Green	Full charge	No action required

^{*}For 90-minute User Tests, wait for full charge. For 30 second User Test, try again after an hour of charging.

TROUBLE SHOOTING

PROBLEM

Lamp failure indicated when there's no lamp failure.

SOLUTION

The product may have calculated a larger lamp load when the lamp load calculation was performed at the first self-diagnostic function test. To reset the lamp failure status, remove the fixture from the wall, disconnect the battery, wait 30 seconds, reconnect the battery, reinstall the fixture onto the mounting plate.

The lamp current calculation will be performed on the next self-test/self-diangostic test.

INFRARED REMOTE TESTING

To activate TRANSMITTER, remove tab from the back of the device.

The USER-TEST can be performed up to 20 feet away using the optional "INFRARED REMOTE TESTING TRANSMITTER". By aiming the transmitter at the legend face and pushing either the "30 SECOND" or "90 MINUTE" button for 1 second. The behavior of the exit sign is the same as when the user tests are initiated from the local test button.

USING THE REMOTE

• Press and hold the 90 seconds test button for up to 10 seconds until the LEDs turn off on their own.

USING THE TEST BUTTON

Press and hold the switch for up to 10 seconds until the LEDs turn off on their own. During
both procedures: The red/green INDICATOR light will FLASH erratically for 10 seconds and
then change to solid red once the main LEDs turn off. This indicates that the battery reset has
been triggered.

NOTE: The fixture will not respond to any remote or switch operations until the battery conditioning is complete, which may take a few hours. However, it will respond to power loss, but full run-time is NOT guaranteed until both conditioning and 24-hour charge cycles are completed.

BATTERY REPLACEMENT

To replace battery, disconnect branch circuit and detach unit from junction box. Unplug battery connector from printed circuit assembly.

For the 16W OLLO, the unit will be supplied with a 9.6V 3300 mAh Lithium Iron Phosphate (LiFePO4 battery), replace with part number B410004 only.

For the HX 16W OLLO, the unit will be supplied with a 9.6V 3300 mAh Lithium Iron Phosphate (LiFePO4 battery) with a heater which will need to be unplugged and replaced with part number A310023 only.

For the 32W and 64W OLLO, the unit will be supplied with a 9.6V 6700 mAh Lithium Iron Phosphate (LiFePO4) battery(s), replace with part number B410002 only.

For the HX 32W and HX 64W OLLO, the unit will be supplied with a 9.6V 6700 mAh Lithium Iron Phosphate (LiFePO4 battery) with a heater which will need to be unplugged and replaced with part number A310024 only. For a HX 64W OLLO, there will be two replacements.

Do not interchange battery types. Used batteries may not be disposed of in the municipal solid waste stream.

For information on local recycling drop-off points, phone toll free 1-800-BATTERY (1-800-228-8379).

BATTERY REPLACEMENT PROCEDURE

- 1. LOOSEN LOCKING SCREW: Loosen the locking screw located on the bottom of the fixture.
- 2. REMOVE THE FIXTURE: Remove the fixture from the wall.
- **3. UNPLUG POWER CONNECTOR:** Unplug the power connector located on the back of the fixture. For HX Option unplug the power connector and heater receptacle
- **4. REMOVE SCREWS:** Remove the 6 screws from the rear of the fixture.
- 5. REMOVE FACE COVER: Carefully remove the face cover, handling the gasket with caution.
- **6. RELEASE BATTERY:** Remove the 2 screws securing the battery holder.
- **7. DISCONNECT BATTERY:** Remove the battery plug and heater, if applicable. For HX Option unplug the power connector and heater receptacle.
- **8. REPLACE BATTERY:** Replace the battery and heater, if applicable.
- 9. **SECURE BATTERY:** Reinstall the 2 screws to secure the battery holders.
- REINSTALL GASKET & COVER: Using caution reinstall the gasket (if applicable) and face cover.
- 11. SECURE FACE COVER: Reinstall the 6 screws to secure the face cover.
- **12. RE-CONNECT POWER:** Re-connect the power connector.
- 13. INSTALL THE FIXTURE: Mount the unit back on the wall.
- 14. TIGHTEN LOCKING SCREW: Tighten the locking screw located on the bottom of the fixture.



SAVE THESE INSTRUCTIONS

31 Waterloo Ave • Berwyn, Pa • 19312 U.S.A Telephone: (610) 647-8200 • Email: support@isolite.com